



RJ12 HAN Interface

Feature Description

Public

Version 1.7 A

Contents

| | | |
|-------|---|----|
| 1 | Preface | 2 |
| 1.1 | Overview..... | 2 |
| 1.2 | System Module support..... | 2 |
| 1.3 | References | 3 |
| 1.4 | Terms and abbreviations | 3 |
| 2 | RJ12 HAN interface | 4 |
| 2.1 | HAN interface role in the AMI system | 4 |
| 2.2 | HAN interface HW structure..... | 4 |
| 2.3 | Transfer speed and character formatting | 6 |
| 3 | Data profiles..... | 7 |
| 3.1 | HAN interface activation | 8 |
| 3.2 | Push setup | 8 |
| 3.3 | EFS data format (IEC62056-7-5)..... | 9 |
| 3.3.1 | Data framing..... | 9 |
| 3.3.2 | Examples of sent data | 10 |
| 3.4 | EFS2 data format (IEC62056-21) | 10 |
| 3.4.1 | Examples of sent data for 6511 | 10 |
| 3.4.2 | Examples of sent data for 6534 | 11 |
| 3.4.3 | Examples of sent data for 6550 | 12 |
| 3.4.4 | Examples of sent data for 6560 | 12 |

1 Preface

1.1 Overview

This document describes the RJ12 HAN interface on Aidon Energy Service Devices (ESD).

The HAN interface in the devices is activated from the Aidon head-end system for direct connected and current transformer connected Meter types.

The RJ12 HAN interface can be activated according to either EFS or EFS2 data profile:

- EFS data profile is a DLMS/COSEM based binary protocol according to 62056-7-5 standard and the Swedish HAN specification.
- EFS2 data profile is an ASCII based protocol, mode D, according to 62056-21 standard, Finnish recommendation and Swedish HAN specification.

Voltage and current transformer connected meters (with more data resolution but without VT or CT constant influence) can be enabled with EFS2 data profile.

See the Aidon System Module types that support the integrated RJ12 HAN from Aidon ESD User Manual (REF7).

1.2 System Module support

The following table lists the supported Aidon System Module types and the System Module software versions in which the data profile is supported onwards from.

| System Module | EFS | EFS2 |
|--|---------------|--------------|
| Aidon 6442, Aidon 6490, Aidon 6492 | ✓ | ✓ (1.4.118→) |
| Aidon 7442, Aidon 7492 | ✓ | ✓ (1.4.118→) |
| Aidon 7410 | Not supported | ✓ (1.2.143→) |

1.3 References

| Reference | Description |
|-----------|---|
| REF1 | IEC 62056-7-5:2016: Electricity metering data exchange – The DLMS/COSEM suite – Part 7-5: Local data transmission profiles for Local Networks (LN) |
| REF2 | IEC 61334-6:2000: Distribution automation using distribution line carrier systems – Part 6: A-XDR encoding rule |
| REF3 | IEC 62056-46:2002+AMD1:2006 CSV Consolidated version: Electricity metering – Data exchange for meter reading, tariff and load control – Part 46: Data link layer using HDLC protocol |
| REF4 | IEC 62056-5-3: Electricity metering data exchange – The DLMS/COSEM suite – Part 5-3: DLMS/COSEM application layer |
| REF5 | EXCERPT DLMS UA Blue Book (latest edition): COSEM interface classes and OBIS identification system |
| REF6 | EFS: Branschrekommendation för lokalt kundgränssnitt för elmätare v1.2 |
| REF7 | Aidon ESD User Manual |
| REF8 | P1 Companion Standard 5.0.2 |
| REF9 | IEC 62056-21:2002 Electricity metering – Data exchange for meter reading, tariff and load control – Part 21: Direct local data exchange |
| REF10 | EFS2: Branschrekommendation för lokalt kundgränssnitt för elmätare v2.0 |
| REF11 | EFS2: Finnish recommendation. SK 13-1:2021 Suositus sähköenergiamittareiden paikallista asiakasrajapintaa varten |

1.4 Terms and abbreviations

| Reference | Description |
|-----------|---|
| EFS | Energiföretagen Sverige, non-profit industry and special interest organisation for companies that supply, distribute, sell, and store energy, mainly electricity, heating, and cooling. It monitors and promotes the interests of its members and the Swedish energy sector in general. |
| HAN | Home Area Network |
| SESKO | National Electrotechnical Standardization Organization representing Finland in the electrotechnical engineering field as the National Committee of the International Electrotechnical Commission (IEC). |

2 RJ12 HAN interface

2.1 HAN interface role in the AMI system

The role of the HAN interface in the AMI system is to provide near real time information for the customer of their energy usage. The following picture below shows where the HAN port is located on the ESD's front of cover.



Figure 1: Integrated HAN interface on Aidon ESD.

2.2 HAN interface HW structure

The Aidon RF2 System Modules have a physical HAN interface that is an implementation of the H1 port described in [REF6] and [REF 8]. The System Modules hold a female RJ12 connector, where the external HAN device (with a male RJ12 connector) can be connected.

The following table shows the pin order of the HAN connector.

| Pin | Signal | Description |
|-----|--------------|--|
| 1 | 5V | +5V power feed to HAN device (250 mA max.) |
| 2 | Data Request | Data request input |
| 3 | GND | - |
| 4 | NC | Not connected |
| 5 | Data | HAN data output (open collector) |
| 6 | GND | - |

Table 1: HAN interface pinout.

The interface is galvanically isolated from mains and Aidon ESD metrology core, as presented in Figure 2.

The +5V power feed to HAN device is controlled by the System Module and can be turned on or off under software control. Maximum current allowed is 250 mA. In the +5V pin there is an overcurrent protection mechanism, which triggers at 280 ± 20 mA. If overcurrent protection triggers, HAN port enters a “hiccup” mode, where +5V power feed is repeatedly turned on for a short time to test, whether the overload condition is still present.

The data request input is activated by HAN device by setting it high (4.0 V/5.0 V/5.5 V, min./nom./max.). The data request input is designed to sink a current of 4.0–10.0 mA when activated. Data request pin is protected against overvoltage, short circuit and negative voltages.

The data output from meter to HAN device is an open collector output. The output low voltage level is max. 1.0V with max. sinking current of 30 mA. Data output is protected against overvoltage, short circuit, and negative voltages.

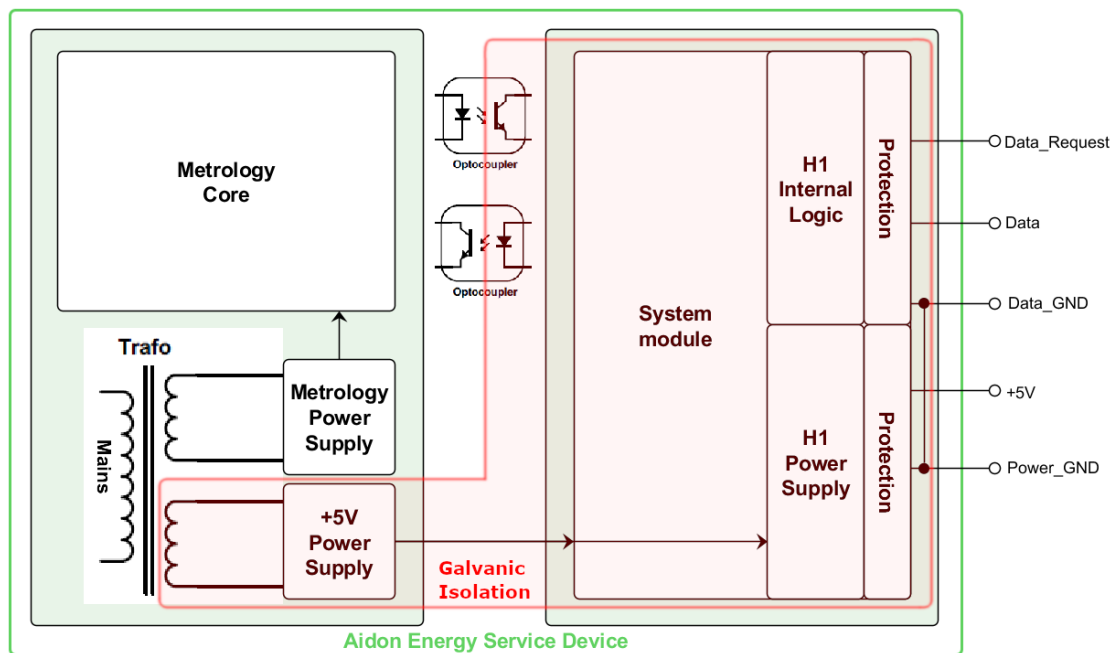


Figure 2: Block diagram of H1 port in Aidon ESD

The interface of the HAN device that is connected to the Aidon ESD has to be double isolated from the mains.

Aidon Meter CE-compliance has been tested with a maximum of a 3-meter cable to the RJ12 connector. Aidon's liability does not apply with longer cable.

2.3 Transfer speed and character formatting

The interface must use a fixed transfer speed of 115200 baud.

The format of transmitted data must be defined as “8N1”. Namely:

- 1 start bit,
- 8 data bits,
- no parity bit, and
- 1 stop bit.

3 Data profiles

The following table lists the available measurements via RJ12 HAN interface that are according to the *Branschrekommendation för lokalt kundgränssnitt för elmätare* [REF6, REF10].

| Data | Unit |
|---|---------------|
| Meter's time and date and normal time indication (X=W meaning wintertime, X=S meaning summertime) | YYMMDDhhmmssX |
| Cumulative hourly active import energy (A+) (Q1+Q4) | kWh |
| Cumulative hourly active export energy (A-) (Q2+Q3) | kWh |
| Cumulative hourly reactive import energy (R+) (Q1+Q2) | kVArh |
| Cumulative hourly reactive export energy (R-) (Q3+Q4) | kVArh |
| Momentary Active power+ (Q1+Q4) | kW |
| Momentary Active power- (Q2+Q3) | kW |
| Momentary Reactive power+ (Q1+Q2) | kVAr |
| Momentary Reactive power- (Q3+Q4) | kVAr |
| Momentary Active power+ (L1) | kW |
| Momentary Active power- (L1) | kW |
| Momentary Active power+ (L2) * | kW |
| Momentary Active power- (L2) * | kW |
| Momentary Active power+ (L3) * | kW |
| Momentary Active power- (L3) * | kW |
| Momentary Reactive power+ (L1) | kVAr |
| Momentary Reactive power- (L1) | kVAr |
| Momentary Reactive power+ (L2) * | kVAr |
| Momentary Reactive power- (L2) * | kVAr |
| Momentary Reactive power+ (L3) * | kVAr |
| Momentary Reactive power- (L3) * | kVAr |
| Momentary RMS Phase voltage L1 | V |
| Momentary RMS Phase voltage L2* | V |
| Momentary RMS Phase voltage L3* | V |
| Momentary RMS Current phase L1 | A |
| Momentary RMS Current phase L2* | A |
| Momentary RMS Current phase L3* | A |

* Not available on 1-phase meters

3.1 HAN interface activation

By default, the interface is not activated and even the power supply to the HAN device is not activated. The activation can be done from the Aidon reading system.

If the HAN interface is activated:

- Power up to 1,25 W can be drawn from the interface
- List is pushed every 10 seconds

3.2 Push setup

The following table describes the push setups for AIDON_H0001 lists. COSEM objects that do not exist for a specific meter type, are not pushed.

| Data | Class ID | OBIS code | Attribute |
|---|----------|----------------|-----------|
| Clock and date in meter | 8 | 0-0:1.0.0.255 | 1,2 |
| Cumulative hourly active import energy (A+) (Q1+Q4) | 3 | 1-0:1.8.0.255 | 0 |
| Cumulative hourly active export energy (A-) (Q2+Q3) | 3 | 1-0:2.8.0.255 | 0 |
| Cumulative hourly reactive import energy (R+) (Q1+Q2) | 3 | 1-0:3.8.0.255 | 0 |
| Cumulative hourly reactive export energy (R-) (Q3+Q4) | 3 | 1-0:4.8.0.255 | 0 |
| Momentary Active power+ (Q1+Q4) | 3 | 1-0:1.7.0.255 | 0 |
| Momentary Active power- (Q2+Q3) | 3 | 1-0:2.7.0.255 | 0 |
| Momentary Reactive power+ (Q1+Q2) | 3 | 1-0:3.7.0.255 | 0 |
| Momentary Reactive power- (Q3+Q4) | 3 | 1-0:4.7.0.255 | 0 |
| Momentary Active power+ (L1) | 3 | 1-0:21.7.0.255 | 0 |
| Momentary Active power- (L1) | 3 | 1-0:22.7.0.255 | 0 |
| Momentary Active power+ (L2) * | 3 | 1-0:41.7.0.255 | 0 |
| Momentary Active power- (L2) * | 3 | 1-0:42.7.0.255 | 0 |
| Momentary Active power+ (L3) * | 3 | 1-0:61.7.0.255 | 0 |
| Momentary Active power- (L3) * | 3 | 1-0:62.7.0.255 | 0 |
| Momentary Reactive power+ (L1) | 3 | 1-0:23.7.0.255 | 0 |
| Momentary Reactive power- (L1) | 3 | 1-0:24.7.0.255 | 0 |
| Momentary Reactive power+ (L2) * | 3 | 1-0:43.7.0.255 | 0 |
| Momentary Reactive power- (L2) * | 3 | 1-0:44.7.0.255 | 0 |
| Momentary Reactive power+ (L3) * | 3 | 1-0:63.7.0.255 | 0 |

| Data | Class ID | OBIS code | Attribute |
|--|----------|-----------------|-----------|
| Momentary Reactive power- (L3) * | 3 | 1-0:64.7.0.255 | 0 |
| Momentary RMS Phase voltage L1 | 3 | 1-0:32.7.0.255 | 0 |
| Momentary RMS Phase voltage L2 * | 3 | 1-0:52.7.0.255 | 0 |
| Momentary RMS Phase voltage L3 * | 3 | 1-0:72.7.0.255 | 0 |
| Momentary RMS Current phase L1 | 3 | 1-0:31.7.0.255 | 0 |
| Momentary RMS Current phase L2 * | 3 | 1-0:51.7.0.255 | 0 |
| Momentary RMS Current phase L3 * | 3 | 1-0:71.7.0.255 | 0 |
| Transformer ratio – current for VT meter | 3 | 1-0:1.4.2.0.255 | 0 |
| Transformer ratio – voltage for VT meter | 3 | 1-0:1.4.3.0.255 | 0 |

* Not available on 1-phase meters.

3.3 EFS data format (IEC62056-7-5)

3.3.1 Data framing

HAN data packets are sent inside an HDLC frame according to [REF6]. The following COSEM classes are used:

- Data (class_id 1)
- Register (class_id 3)
- Clock (class_id 8)

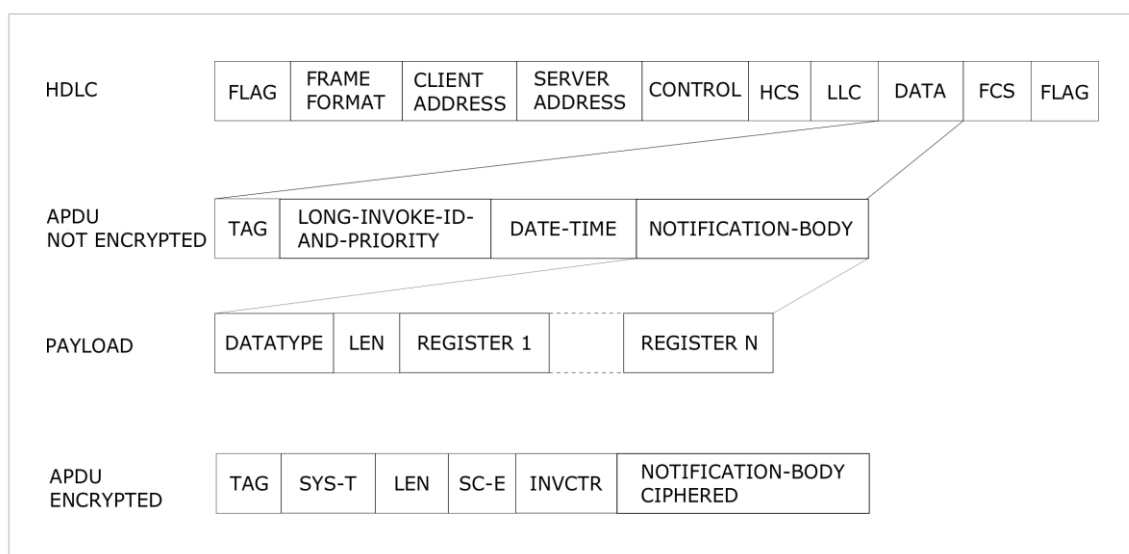


Figure 3: Data format.

3.3.2 Examples of sent data

3.3.2.1 List from 3-phase ESD

```
7e a243 41 0883 13 85eb e6e700
0f 40000000 00
011b
0202 0906 0000010000ff 090c 07e30c1001073b28ff8000ff
0203 0906 0100010700ff 06 00000462 0202 0f00 161b
0203 0906 0100020700ff 06 00000000 0202 0f00 161b
0203 0906 0100030700ff 06 000005e3 0202 0f00 161d
0203 0906 0100040700ff 06 00000000 0202 0f00 161d
0203 0906 01001f0700ff 10 00000202 0fff 1621
0203 0906 0100330700ff 10 004b0202 0fff 1621
0203 0906 0100470700ff 10 00000202 0fff 1621
0203 0906 0100200700ff 12 09030202 0fff 1623
0203 0906 0100340700ff 12 09c30202 0fff 1623
0203 0906 0100480700ff 12 09040202 0fff 1623
0203 0906 0100150700ff 06 00000000 0202 0f00 161b
0203 0906 0100160700ff 06 00000000 0202 0f00 161b
0203 0906 0100170700ff 06 00000000 0202 0f00 161d
0203 0906 0100180700ff 06 00000000 0202 0f00 161d
0203 0906 0100290700ff 06 00000462 0202 0f00 161b
0203 0906 01002a0700ff 06 00000000 0202 0f00 161b
0203 0906 01002b0700ff 06 000005e2 0202 0f00 161d
0203 0906 01002c0700ff 06 00000000 0202 0f00 161d
0203 0906 01003d0700ff 06 00000000 0202 0f00 161b
0203 0906 01003e0700ff 06 00000000 0202 0f00 161b
0203 0906 01003f0700ff 06 00000000 0202 0f00 161d
0203 0906 0100400700ff 06 00000000 0202 0f00 161d
0203 0906 0100010800ff 06 00995986 0202 0f00 161e
0203 0906 0100020800ff 06 00000008 0202 0f00 161e
0203 0906 0100030800ff 06 0064ed4b 0202 0f00 1620
0203 0906 0100040800ff 06 00000005 0202 0f00 1620
be40 7e
```

3.4 EFS2 data format (IEC62056-21)

HAN data is sent in ASCII format [REF10] according to Protocol mode D in [REF9] at fixed baud rate of 115200.

3.4.1 Examples of sent data for 6511

```
/ADN9 6511

0-0:1.0.0 (213112235959W)
1-0:1.8.0 (12345678.123*kWh)
1-0:2.8.0 (12345678.123*kWh)
1-0:3.8.0 (12345678.123*kVArh)
```

1-0:4.8.0 (12345678.123*kVArh)
1-0:1.7.0 (1234.123*kW)
1-0:2.7.0 (1234.123*kW)
1-0:3.7.0 (1234.123*kVAr)
1-0:4.7.0 (1234.123*kVAr)
1-0:21.7.0 (1234.123*kW)
1-0:22.7.0 (1234.123*kW)
1-0:23.7.0 (1234.123*kVAr)
1-0:24.7.0 (1234.123*kVAr)
1-0:32.7.0 (123.1*v)
1-0:31.7.0 (123.1*A) !

3.4.2 Examples of sent data for 6534

/ADN9 6534

0-0:1.0.0 (213112235959W)
1-0:1.8.0 (12345678.123*kWh)
1-0:2.8.0 (12345678.123*kWh)
1-0:3.8.0 (12345678.123*kVarh)
1-0:4.8.0 (12345678.123*kVarh)
1-0:1.7.0 (1234.123*kW)
1-0:2.7.0 (1234.123*kW)
1-0:3.7.0 (1234.123*kVAr)
1-0:4.7.0 (1234.123*kVAr)
1-0:21.7.0 (1234.123*kW)
1-0:22.7.0 (1234.123*kW)
1-0:41.7.0 (1234.123*kW)
1-0:42.7.0 (1234.123*kW)
1-0:61.7.0 (1234.123*kW)
1-0:62.7.0 (1234.123*kW)
1-0:23.7.0 (1234.123*kVAr)
1-0:24.7.0 (1234.123*kVAr)
1-0:43.7.0 (1234.123*kVAr)
1-0:44.7.0 (1234.123*kVAr)
1-0:63.7.0 (1234.123*kVAr)
1-0:64.7.0 (1234.123*kVAr)
1-0:32.7.0 (123.1*v)
1-0:52.7.0 (123.1*v)
1-0:72.7.0 (123.1*v)
1-0:31.7.0 (123.1*A)
1-0:51.7.0 (123.1*A)
1-0:71.7.0 (123.1*A) !

3.4.3 Examples of sent data for 6550

/ADN9 6550

```
0-0:1.0.0 (213112235959W)
1-0:1.8.0 (12345678.123*kWh)
1-0:2.8.0 (12345678.123*kWh)
1-0:3.8.0 (12345678.123*kVArh)
1-0:4.8.0 (12345678.123*kVArh)
1-0:1.7.0 (1234.123*kW)
1-0:2.7.0 (1234.123*kW)
1-0:3.7.0 (1234.123*kVAr)
1-0:4.7.0 (1234.123*kVAr)
1-0:21.7.0 (1234.123*kW)
1-0:22.7.0 (1234.123*kW)
1-0:41.7.0 (1234.123*kW)
1-0:42.7.0 (1234.123*kW)
1-0:61.7.0 (1234.123*kW)
1-0:62.7.0 (1234.123*kW)
1-0:23.7.0 (1234.123*kVAr)
1-0:24.7.0 (1234.123*kVAr)
1-0:43.7.0 (1234.123*kVAr)
1-0:44.7.0 (1234.123*kVAr)
1-0:63.7.0 (1234.123*kVAr)
1-0:64.7.0 (1234.123*kVAr)
1-0:32.7.0 (123.1*v)
1-0:52.7.0 (123.1*v)
1-0:72.7.0 (123.1*v)
1-0:31.7.0 (123.1*A)
1-0:51.7.0 (123.1*A)
1-0:71.7.0 (123.1*A) !
```

Note! Data presented with primary values when the current transformer constant has been added from system.

3.4.4 Examples of sent data for 6560

/ADN9 6560

```
0-0:1.0.0 (210729140950W)
1-0:1.8.0 (01219311.383*Wh)
1-0:2.8.0 (00003281.871*Wh)
1-0:3.8.0 (00016166.083*VArh)
1-0:4.8.0 (00051630.914*VArh)
1-0:1.7.0 (0000.000*W)
```

1-0:2.7.0 (0000.000*W)
1-0:3.7.0 (0000.000*VAr)
1-0:4.7.0 (0000.000*VAr)
1-0:21.7.0 (0000.000*W)
1-0:22.7.0 (0000.000*W)
1-0:41.7.0 (0000.000*W)
1-0:42.7.0 (0000.000*W)
1-0:61.7.0 (0000.000*W)
1-0:62.7.0 (0000.000*W)
1-0:23.7.0 (0000.000*VAr)
1-0:24.7.0 (0000.000*VAr)
1-0:43.7.0 (0000.000*VAr)
1-0:44.7.0 (0000.000*VAr)
1-0:63.7.0 (0000.000*VAr)
1-0:64.7.0 (0000.000*VAr)
1-0:32.7.0 (057.1*V)
1-0:52.7.0 (057.1*V)
1-0:72.7.0 (057.1*V)
1-0:31.7.0 (000.0*A)
1-0:51.7.0 (000.0*A)
1-0:71.7.0 (000.0*A)
1-0:0.4.2 (995)
1-0:0.4.3 (000.01)
!9AD0

Note! Data presented always with secondary values.